


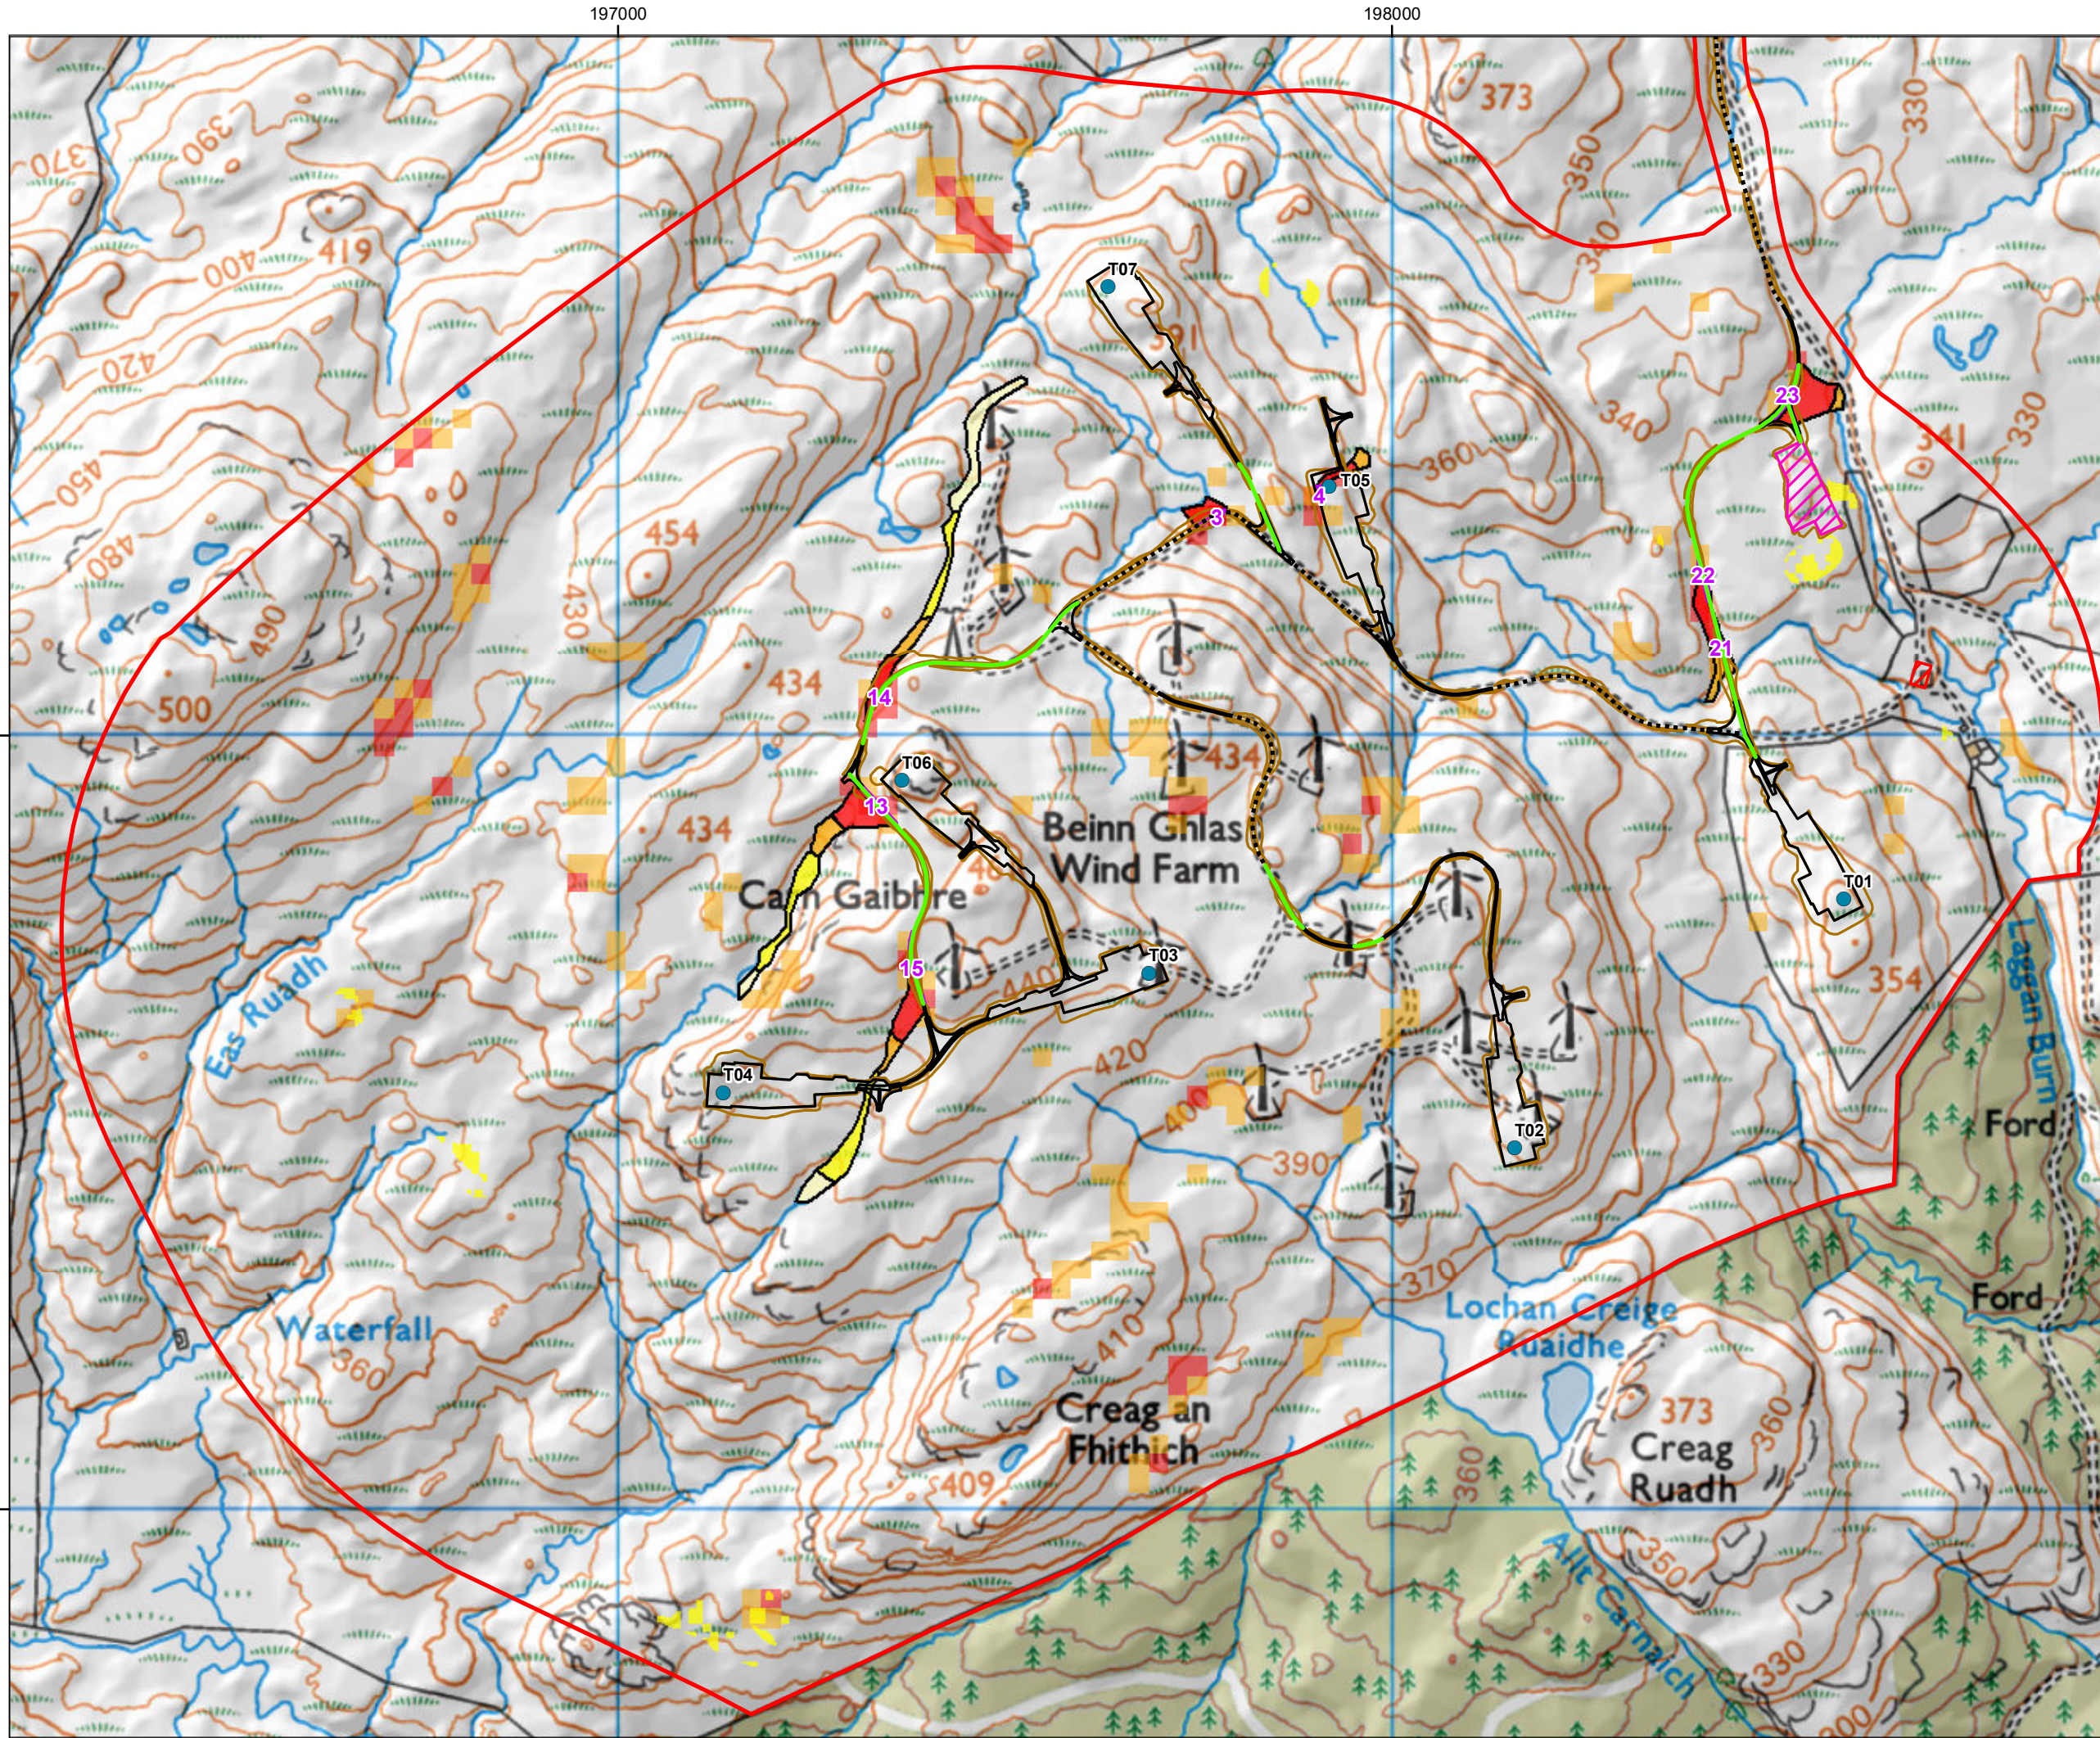

Legend:

- Site Boundary
- Turbines
- Hardstandings
- New Road (Cut and Fill)
- New Road (Floating)
- Earthworks
- Met Mast
- Site Compound
- Substation

Source Zones

- Source Zones

Runout Zones

- 0 - 50
- 50 - 100
- 100 - 250
- 250 - 500

Likelihood

- 13 - 17 (Moderate)
- 18 - 21 (High)
- 22 - 24 (Very High)

Factor of Safety (Best Estimate and Crane-Loaded)

- <1.0 (Unstable)
- 1.0 - 1.4 (Marginally stable)

Coordinate System: British National Grid
Projection: Transverse Mercator
Datum: OSGB 1936
Units: Meter

01	09/07/2025	Revised Layout	AM	DS	DS
00	10/07/2025	First Draft	RH	AM	DS
Rev	Date	Description	Drn	Chk	App

Beinn Ghlas Wind Farm Repowering

TITLE:

Figure 8.4.10
Source and Runout Zones

ID:P663544_TAG000_Layout_A3_L

0

0.1

0.2

Kilometres

SCALE: 1:8,000 @ A3

N

W

E

S

REV 00