


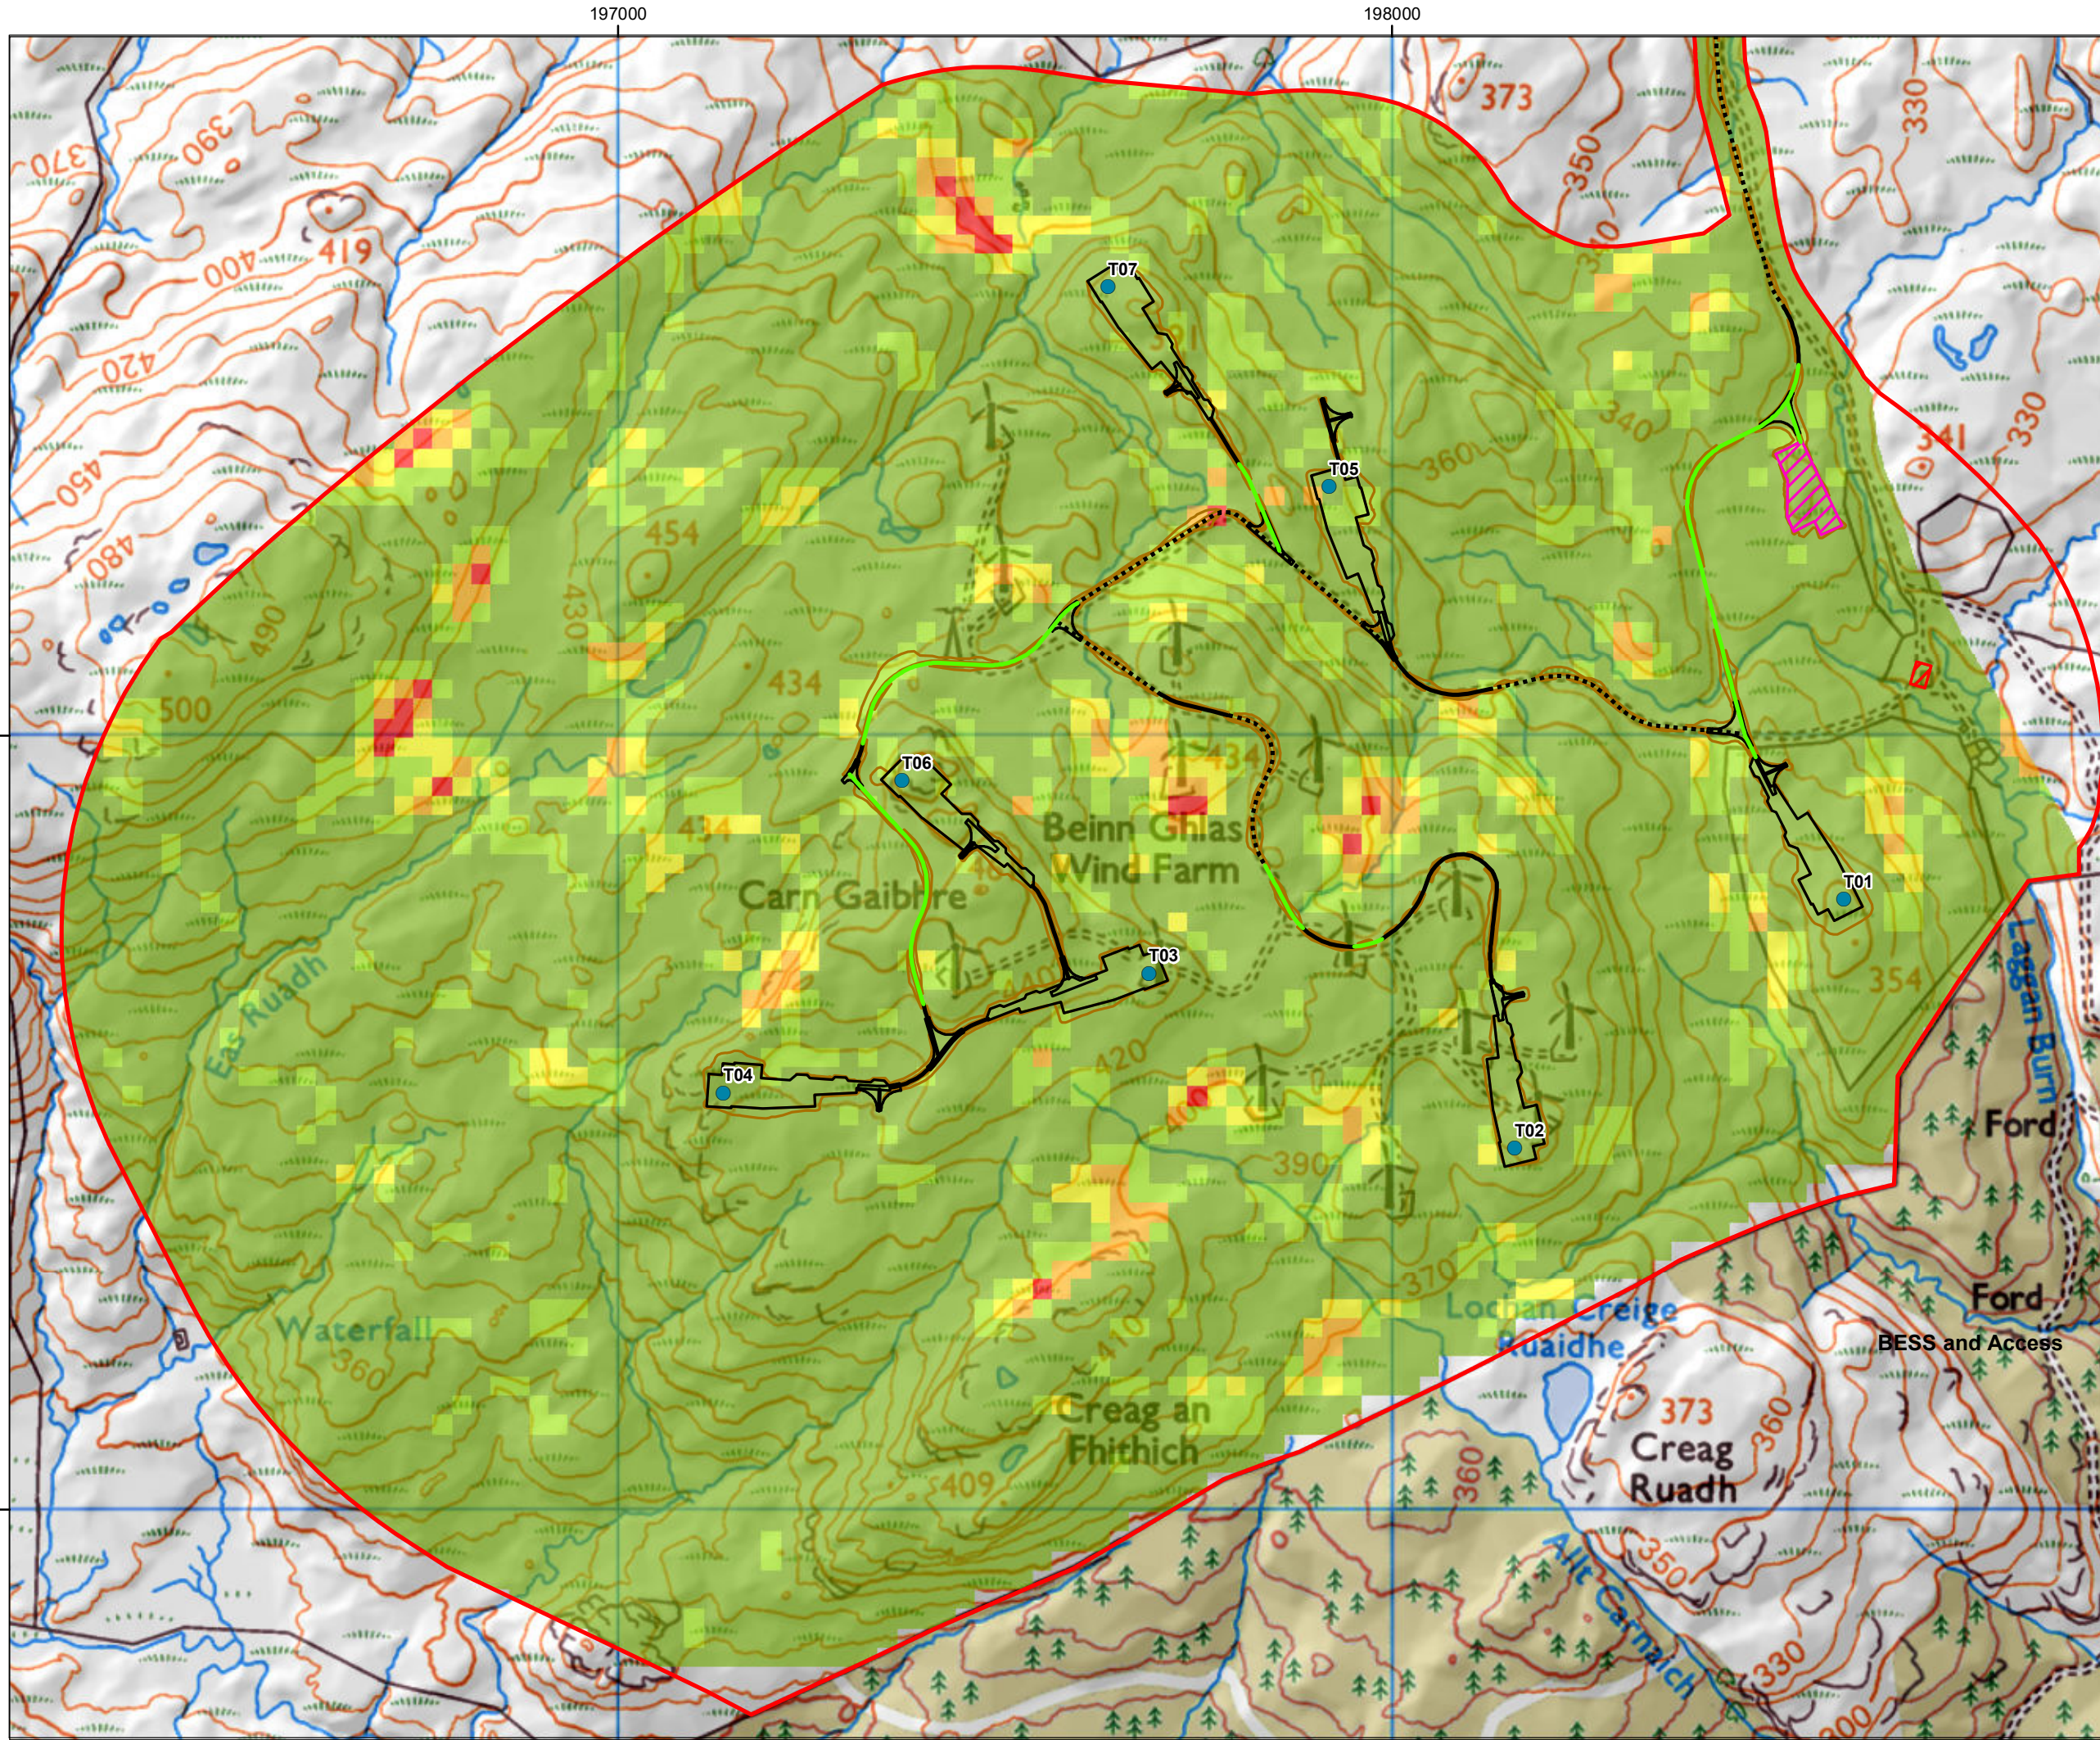

Legend:

- Site Boundary
- Turbines
- Hardstandings
- New Road (Cut and Fill)
- New Road (Floating)
- Earthworks
- Met Mast
- Site Compound
- Substation

Factor of Safety (Best Estimate)

- <1.0 (Unstable)
- 1.0 - 1.4 (Marginally stable)
- 1.4 - 2.0 (Stable)
- 2.0 - 3.0 (Stable)
- >3.0 (Stable)

Coordinate System: British National Grid
Projection: Transverse Mercator
Datum: OSGB 1936
Units: Meter

01	09/07/2025	Revised Layout	AM	DS	DS
00	09/07/2025	First Draft	RH	AM	DS
Rev	Date	Description	Drn	Chk	App

Beinn Ghlas Wind Farm Repowering

TITLE:
Figure 8.4.6
Factor of Safety

ID:P663544_TAG000_Layout_A3_L

01 Kilometres

SCALE: 1:8,000 @ A3

N
W
E
S

REV 00

Document Path: C:\GIS\22-FEC-023\MAP_P\Projects\Revised Submission 2025\Beinn Ghlas PLHRA Figure 9.4.6 FactorOfSafety 250709.mxd